


KEYNOTES

- ① Concrete Substrate
- ② MACoat System
- ③ Backer Rod
- ④ Polyurethane Joint Sealant (by others)

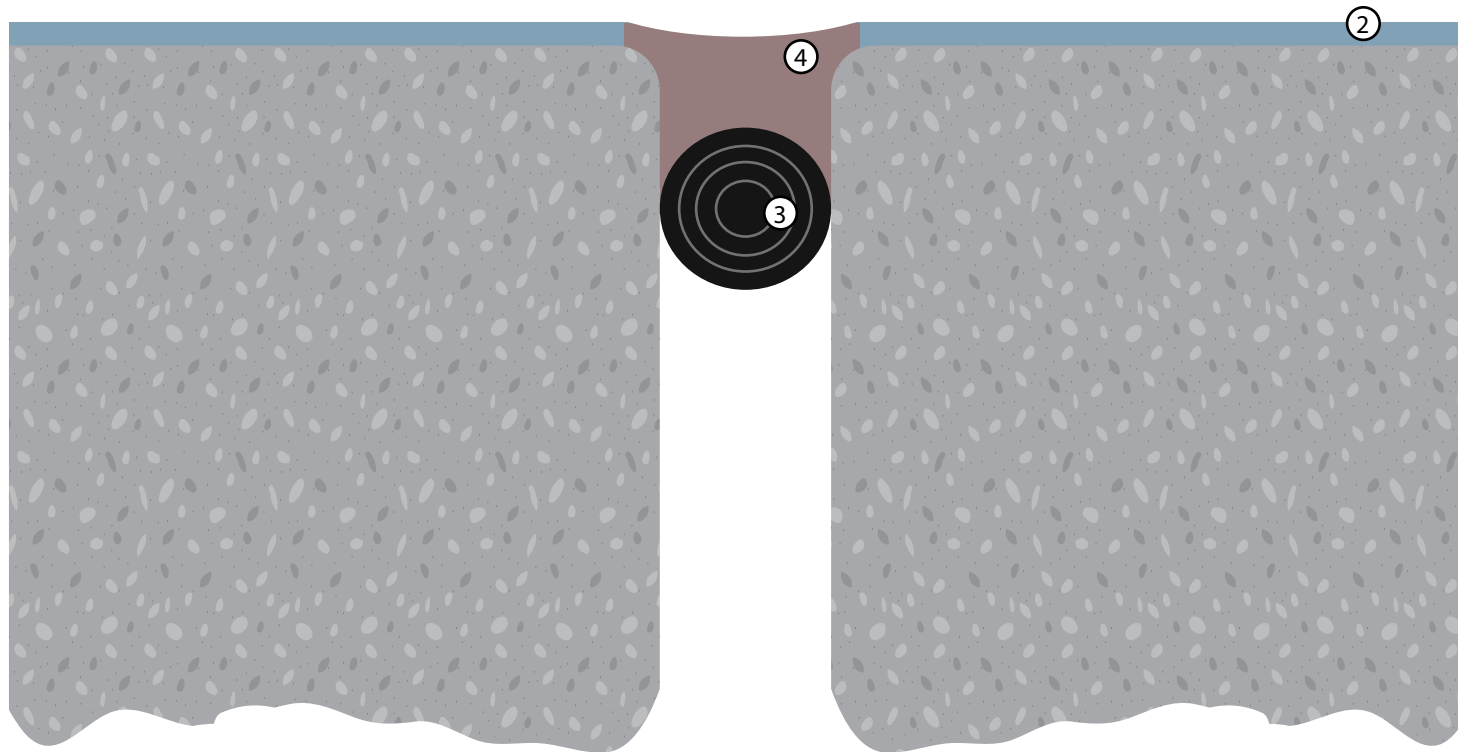

- Concrete must be a minimum 2,500 PSI.
- Concrete must be cured for a minimum 28 days.
- Concrete should be prepared to a profile equal to ICRI CSP 3.
- Refer to local building codes and standards.
- Refer to all Product and System Specifications for additional information.

REV. 9/4/20 TC

MACOAT SYSTEM - EXPANSION JOINT DETAIL

DIVISION 07 18 13
Pedestrian Traffic Coatings

SCALE : NTS



westcoat
SPECIALTY COATING SYSTEMS

4007 Lockridge Street • San Diego, CA • 92102
800.250.4519 • westcoat.com