


KEYNOTES

- ① Concrete Substrate
- ② EC-15 MVB (min. 16 mils.)
- ③ Backer Rod
- ④ Joint Sealant

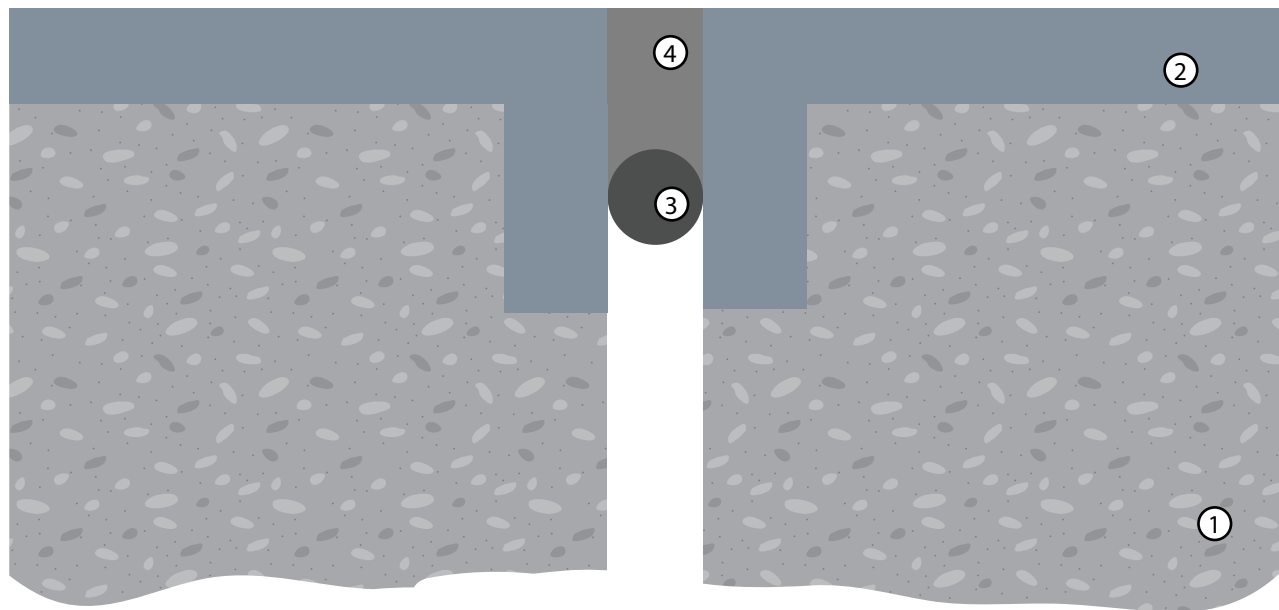

- Concrete must be a minimum 3,000 PSI.
- Concrete must be cured for a minimum 7-10 days.
- Concrete should be prepared to a profile equal to ICRI CSP 3-4.
- Refer to local building codes and standards.
- Refer to all Product and System Specifications for additional information.

REV. 10/21/19 - TC

EC-15 MVB - EXPANSION JOINT

DIVISION 09 05 61.13
Moisture Vapor Emission Control

SCALE : NTS



westcoat
SPECIALTY COATING SYSTEMS

4007 Lockridge Street • San Diego, CA • 92102
800.250.4519 • westcoat.com