


# KEYNOTES

- ① Concrete Substrate
- ② Temper-Crete Coat
- ③ Flexible Joint Sealant
- ④ Anchor Keyway

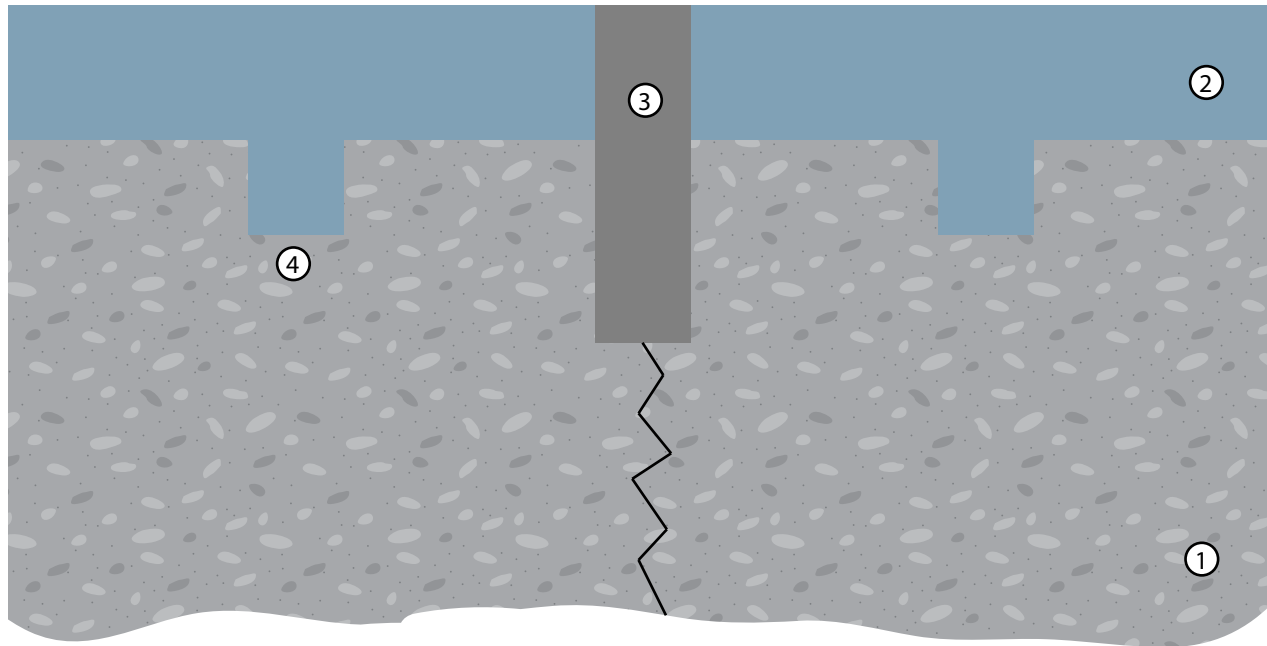

- Concrete must be a minimum 3,500 PSI.
- Concrete must be cured for a minimum 14 days.
- Control joint should be cut down ~ 1/3 the depth of the substrate.
- Concrete should be prepared to a profile equal to ICRI CSP 3-6.
- Refer to local building codes and standards.
- Refer to all Product and System Specifications for additional information.

REV. 1/20/19 TC

## TEMPER-CRETE - CONTROL JOINT (MOVEMENT)

DIVISION 09 67 23  
Resinous Flooring

SCALE : NTS



**westcoat**  
SPECIALTY COATING SYSTEMS

4007 Lockridge Street • San Diego, CA • 92102  
800.250.4519 • westcoat.com