


KEYNOTES

- ① Concrete Substrate
- ② Shur Deck Over Concrete System
- ③ Backer Rod (by others)
- ④ Polyurethane Joint Sealant (by others)

ER-517

- Concrete must be a minimum 2,500 PSI.
- Concrete must be cured for a minimum 28 days.
- Concrete should be prepared to a profile equal to ICRI CSP 3.
- Refer to local building codes and standards.
- Refer to all Product and System Specifications for additional information.

All details are for reference only and should be evaluated by architect. These details are not a substitute for specifications, plans or evaluation reports. Architect, consultant or similar professional should review prior to major waterproofing applications.

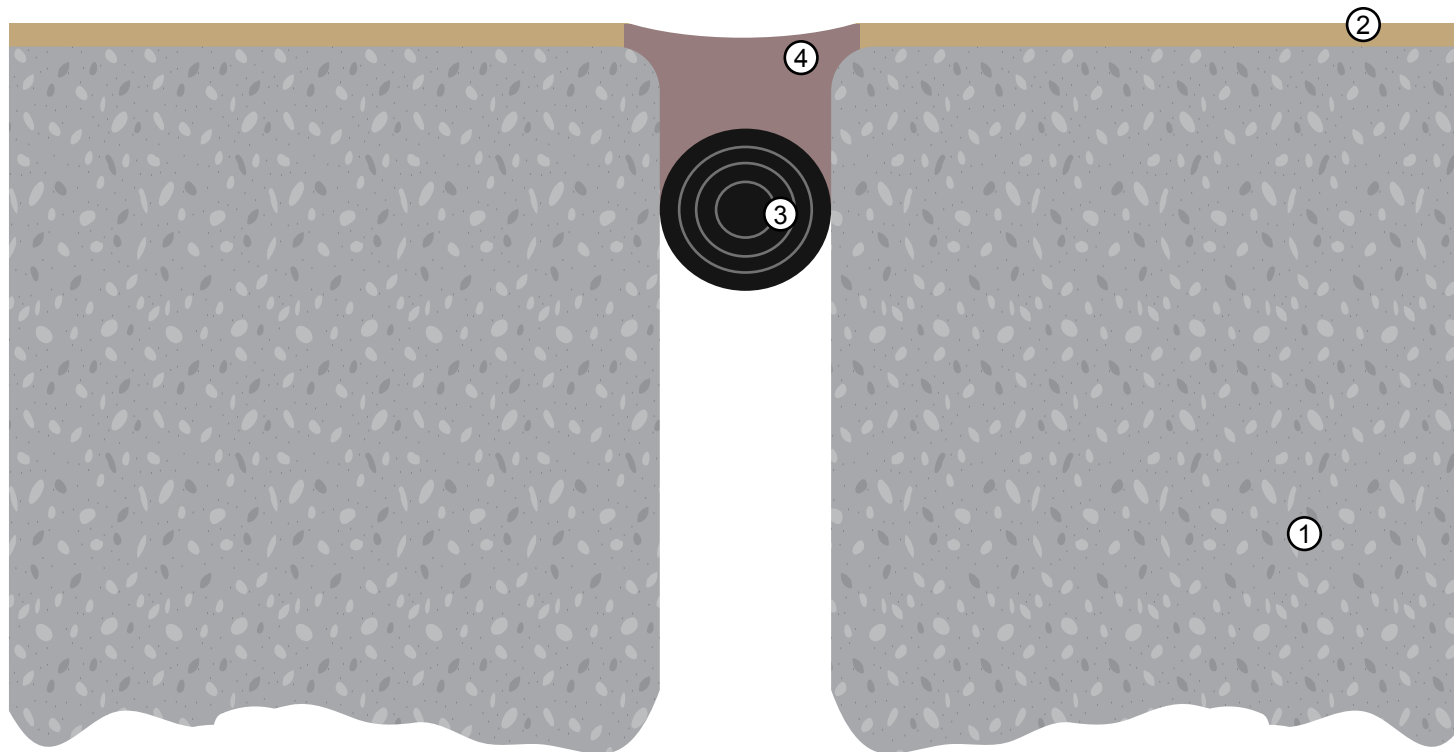

REV. 5/15/25 TC

SHUR DECK OVER CONCRETE - EXPANSION JOINT DETAIL

DIVISION 07 18 13
Pedestrian Traffic Coatings

SCALE : NTS



westcoat®

4007 Lockridge Street • San Diego, CA • 92102
800.250.4519 • westcoat.com